




NATIONALTURBINE CORPORATION
374 Northern Lights Drive
Syracuse, NY 13212
888-293-7434 fax 315-455-5545
www.nationalturbine.com
sales@nationalturbine.com

CONTROLS

DIGITAL SURGE, OVERLOAD AND BEARING VIBRATION MONITOR SYSTEM

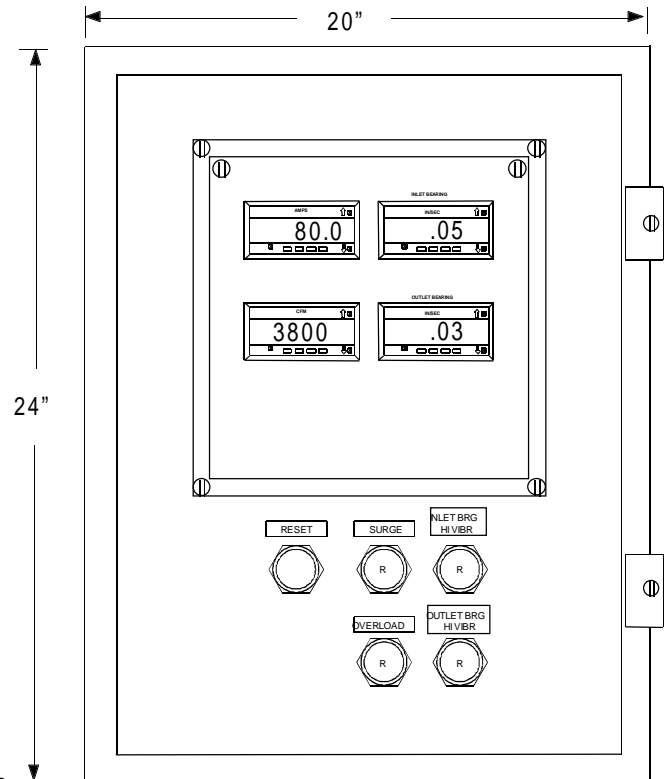

PROTECTION

- Blower surge & motor overload warning and shutdown
- Blower inlet & outlet bearing high vibration shutdown

FUNCTION

- Programmable set points for both warning and shutdown

DISPLAY

- Motor AMPS & blower FLOW
- Inlet & outlet bearing vibration levels

ANNUNCIATION

- Pilot lights for surge, motor overload, high inlet and outlet bearing vibration shutdown
- Digital meter LED indicates warning level exceeded

ENCLOSURE

- NEMA 12 size in inches 24H x 20W x 8D

PANEL COMPONENTS

- Digital ammeter and digital CFM meter
- Digital inlet & outlet vibration meters
- Adjustable start delay timer
- Four red LED type full voltage pilot lights
- RESET push button

FIELD COMPONENTS

- Current transformer furnished loose
- Two vibration transmitters furnished loose

PART NUMBER - NECD200

COPYRIGHT 1998-2002 NATIONAL TURBINE CORPORATION

013102

CD-7100-00