




NATIONALTURBINE CORPORATION
374 Northern Lights Drive
Syracuse, NY 13212
888-293-7434 fax 315-455-5545
www.nationalturbine.com
sales@nationalturbine.com

CONTROLS

BEARING TEMPERATURE MONITOR AND SHUTDOWN WITH ALARMLIGHTS

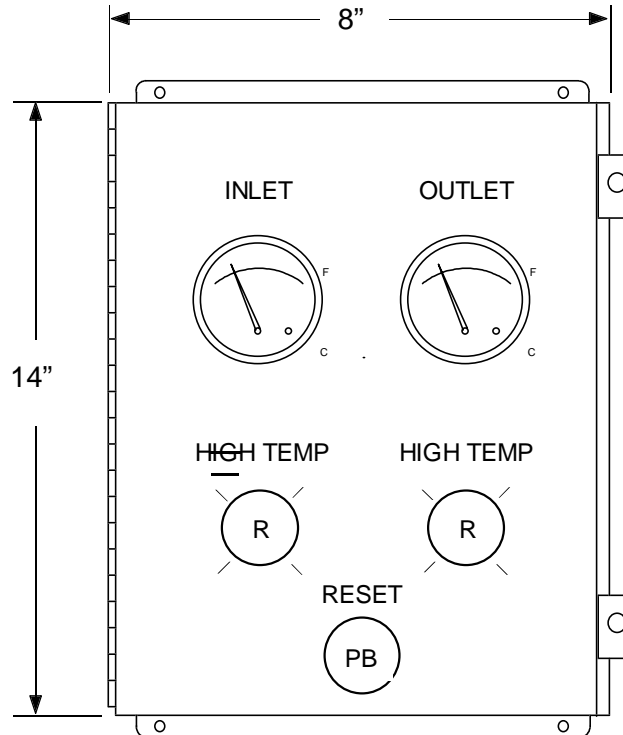

PROTECTION

- Blower inlet & outlet bearing high temperature shutdown

DISPLAY

- Inlet & outlet bearing temperature

ANNUNCIATION

- adjustable set point with contact
- pilot light for each bearing

ENCLOSURE

- NEMA 12 size in inches 10H x 8W x 6D

PANEL COMPONENTS

- Two analog temperature gages
- Two red LED type full voltage pilot lights
- RESET push button

FIELD COMPONENTS

- Liquid filled bulb with 25 ft. capillary is integral with panel mounted gages

PART NUMBER ABT02

COPYRIGHT 1998-2002 NATIONAL TURBINE CORPORATION

013102

TP-7045-00