




NATIONALTURBINE CORPORATION  
374 Northern Lights Drive  
Syracuse, NY 13212  
888-293-7434 fax 315-455-5545  
www.nationalturbine.com  
sales@nationalturbine.com

## CONTROLS

### VIBRATION PROTECTION, SECTION MOUNTED

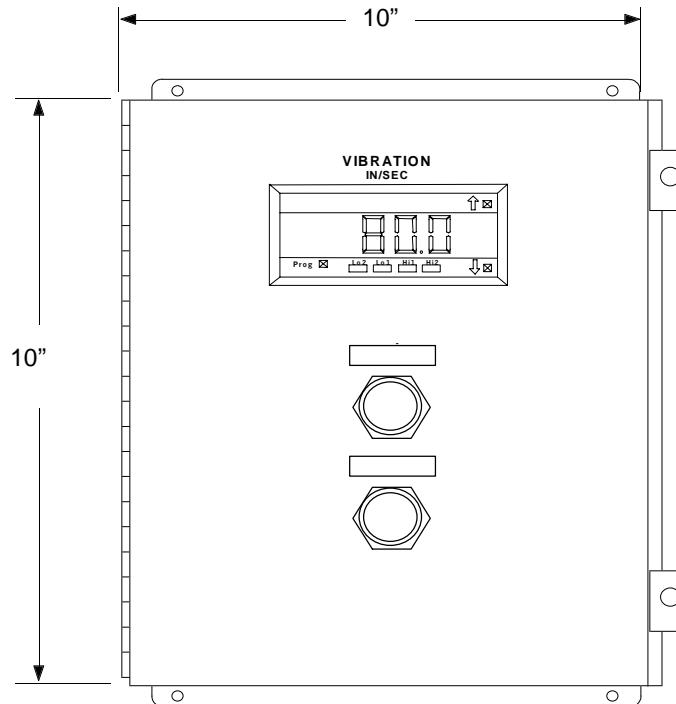

#### **PROTECTION**

- Blower single point section mounted vibration shutdown

#### **FUNCTION**

- Programmable set points for both warning and shutdown levels

#### **DISPLAY**

- Blower casing vibration

#### **ANNUNCIATION**

- Pilot light indicating shutdown
- Digital meter LED indicates warning level exceeded

#### **ENCLOSURE**

- NEMA 12 size in inches 10H x 8W x 6D

#### **PANEL COMPONENTS**

- Digital vibration meter
- Adjustable start delay timer
- One red LED type full voltage pilot light
- RESET push button

#### **FIELD COMPONENTS**

- Vibration transmitter furnished loose

PART NUMBER- VTRANS C

COPYRIGHT 1998-2002 NATIONAL TURBINE CORPORATION

013102

VP-7050-00